


40 Amp Configuration
 PN: IN-P/DIS-PS-40-480

11 51/64 [299.83]

11 13/16 [300.00]

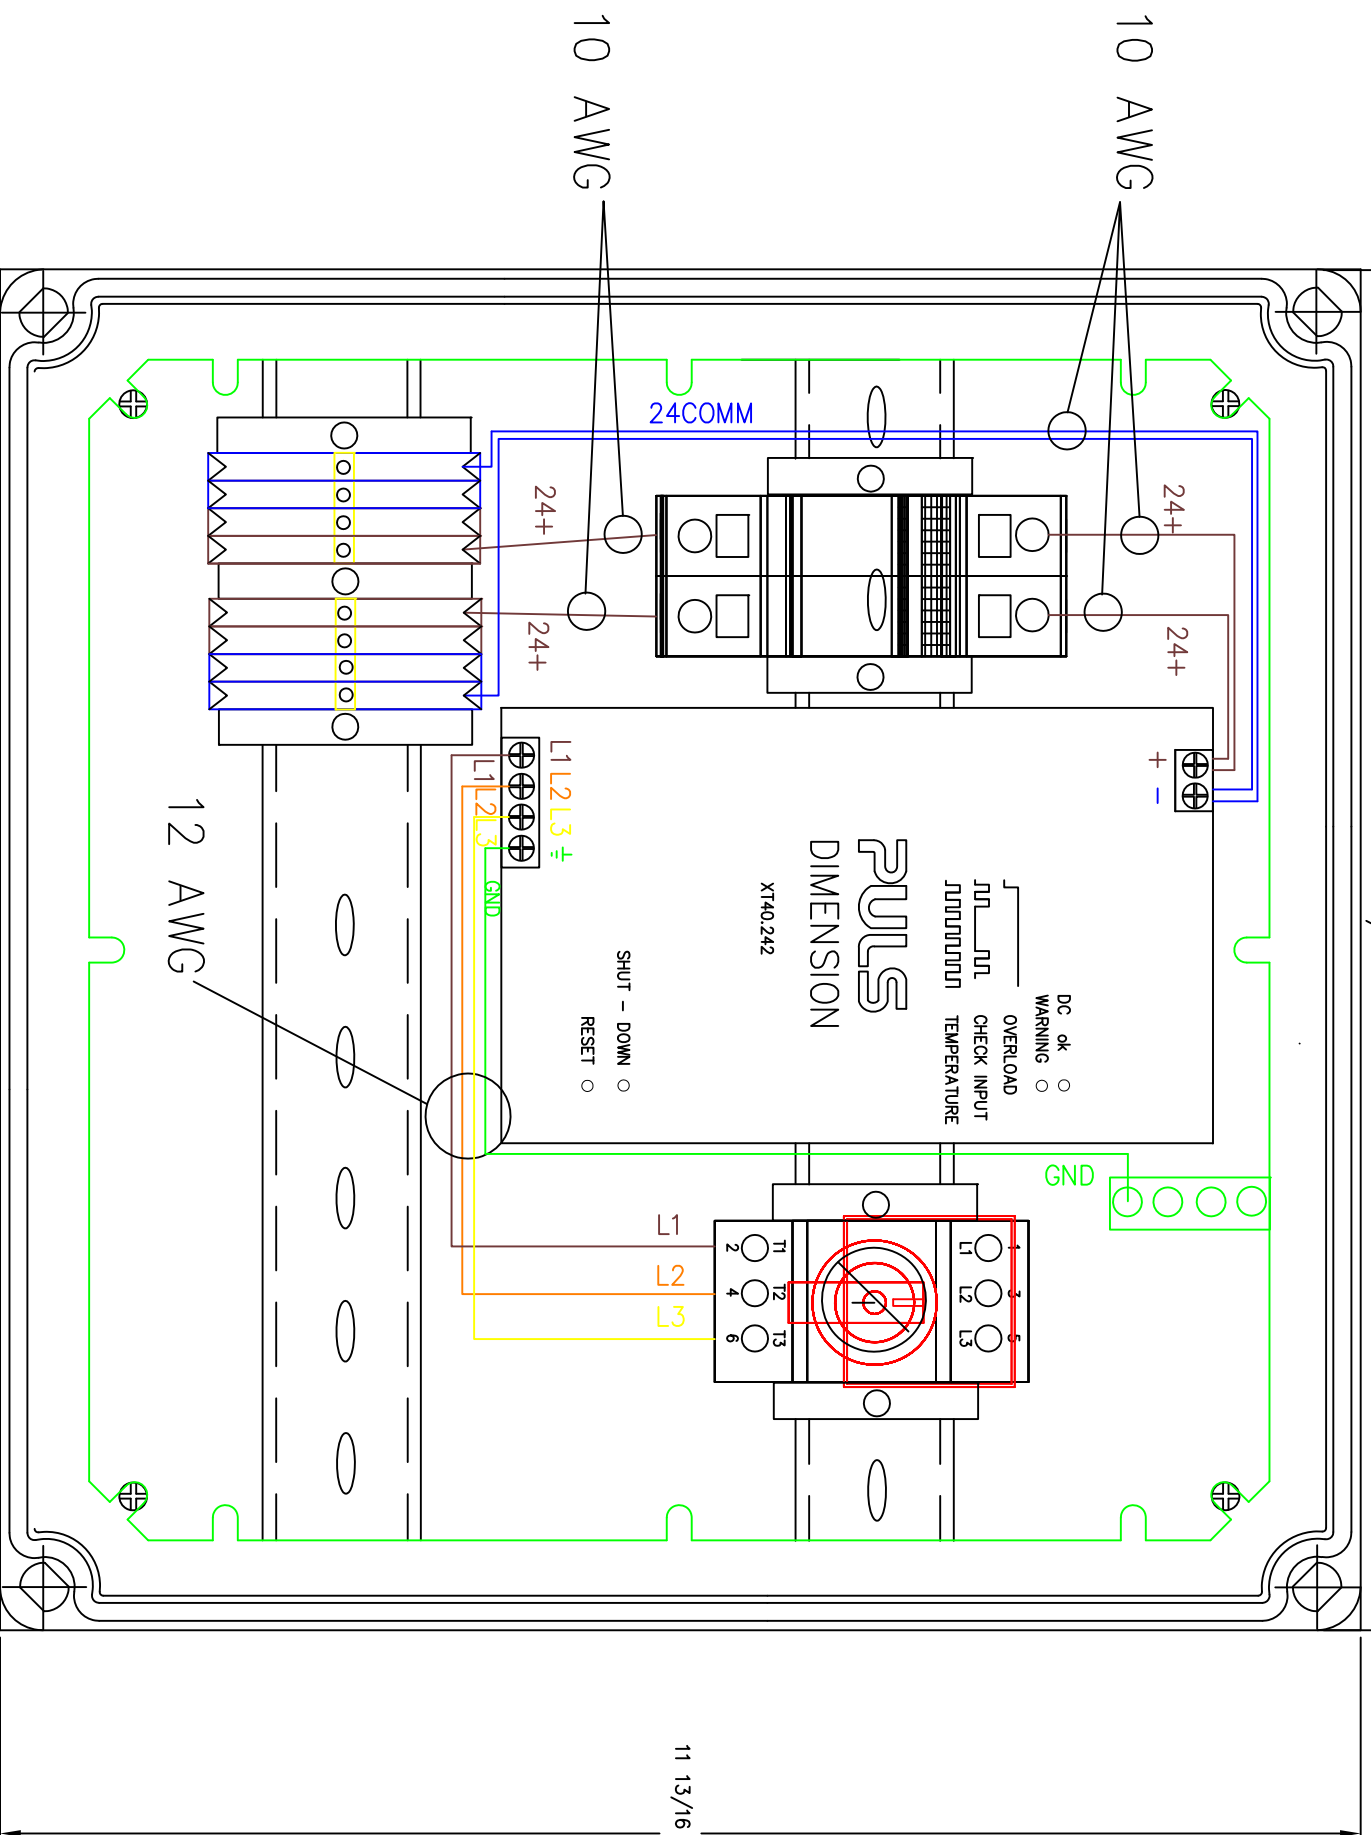

REV.	DATE	DESCRIPTION	ADDED REF. #'s
A	8/4/09		

DATE:	7/17/09	CUST.NO:	
DESIGNED BY:	T.R.	EST.NO:	
CHECKED BY:		ORD.NO:	
SCALE:	NONE	SHEET:	
DWG. NO:		REV:	

INSIGHT
 Automation


2748 Circleport Drive
 Erlanger, KY 41018
 (859) 647-1111

TITLE: MDR POWER
 40 Amp 480 VAC

FOR: PULS IN-P/DIS-PS-40-480

THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF INSIGHT AUTOMATION, INC. AND SHALL BE USED ONLY IN CONNECTION WITH THE CONTRACT OF WHICH THIS DRAWING FORMS A PART, AND SHALL NOT, WITHOUT INSIGHT AUTOMATION, INC. PRIOR WRITTEN APPROVAL, BE REPRODUCED OR IN ANY OTHER WAY USED IN WHOLE OR IN PART BY OTHERS.

11 51/64 [299.69]
 20 Amp Configuration
 PN: IN-P/DIS-PS-20-480

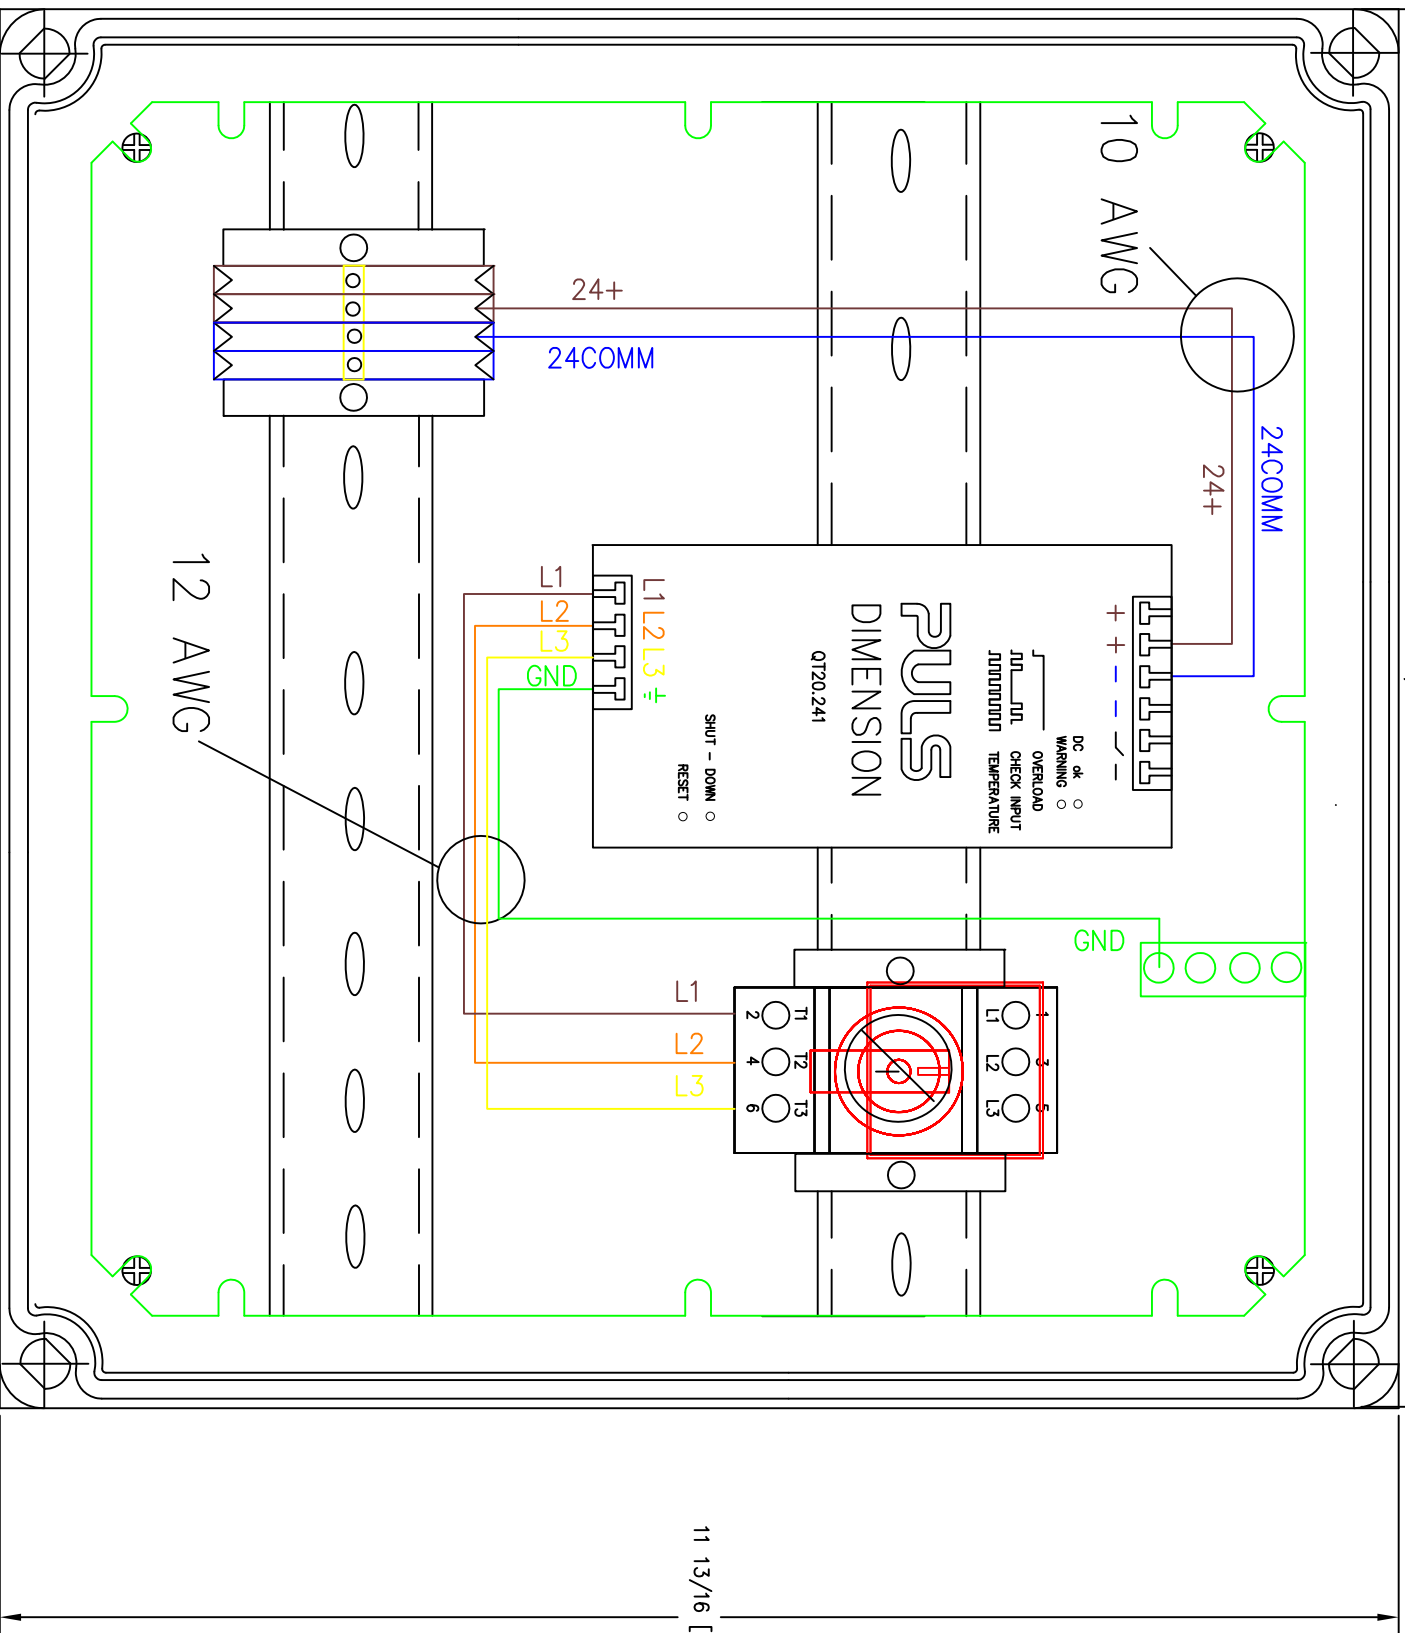


11 13/16 [300.00]



REV.	DATE	DESCRIPTION	ADDED REF. #'S
A	8/4/09		
THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF INSIGHT AUTOMATION, INC. AND IS NOT TO BE REPRODUCED OR TRANSMITTED IN ANY FORM OR BY ANY MEANS, ELECTRONIC OR MECHANICAL, INCLUDING PHOTOCOPYING, RECORDING, OR BY ANY INFORMATION STORAGE AND RETRIEVAL SYSTEM. ANY UNAUTHORIZED USE OF THIS INFORMATION IS STRICTLY PROHIBITED. INSIGHT AUTOMATION, INC. SHALL BE USED ONLY IN CONNECTION WITH THE PERFORMANCE OF THE CONTRACT OF WHICH THIS DRAWING FORMS A PART, AND SHALL NOT, WITHOUT INSIGHT AUTOMATION, INC. PRIOR WRITTEN APPROVAL, BE REPRODUCED OR IN ANY OTHER WAY USED IN WHOLE OR IN PART BY OTHERS.			
DATE:	7/17/09	QUST.NO:	
DESIGNED BY:	T.R.	EST.NO:	
CHECKED BY:		ORD.NO:	
SCALE:	NONE	SHEET:	
TITLE:	MDR POWER 20 Amp 480 VAC		
FOR:	PULS IN-P/DIS-PS-20-480		
DWG. NO:		REV:	

20 Amp Configuration
 PN: IN-P/DIS-PS-20-120

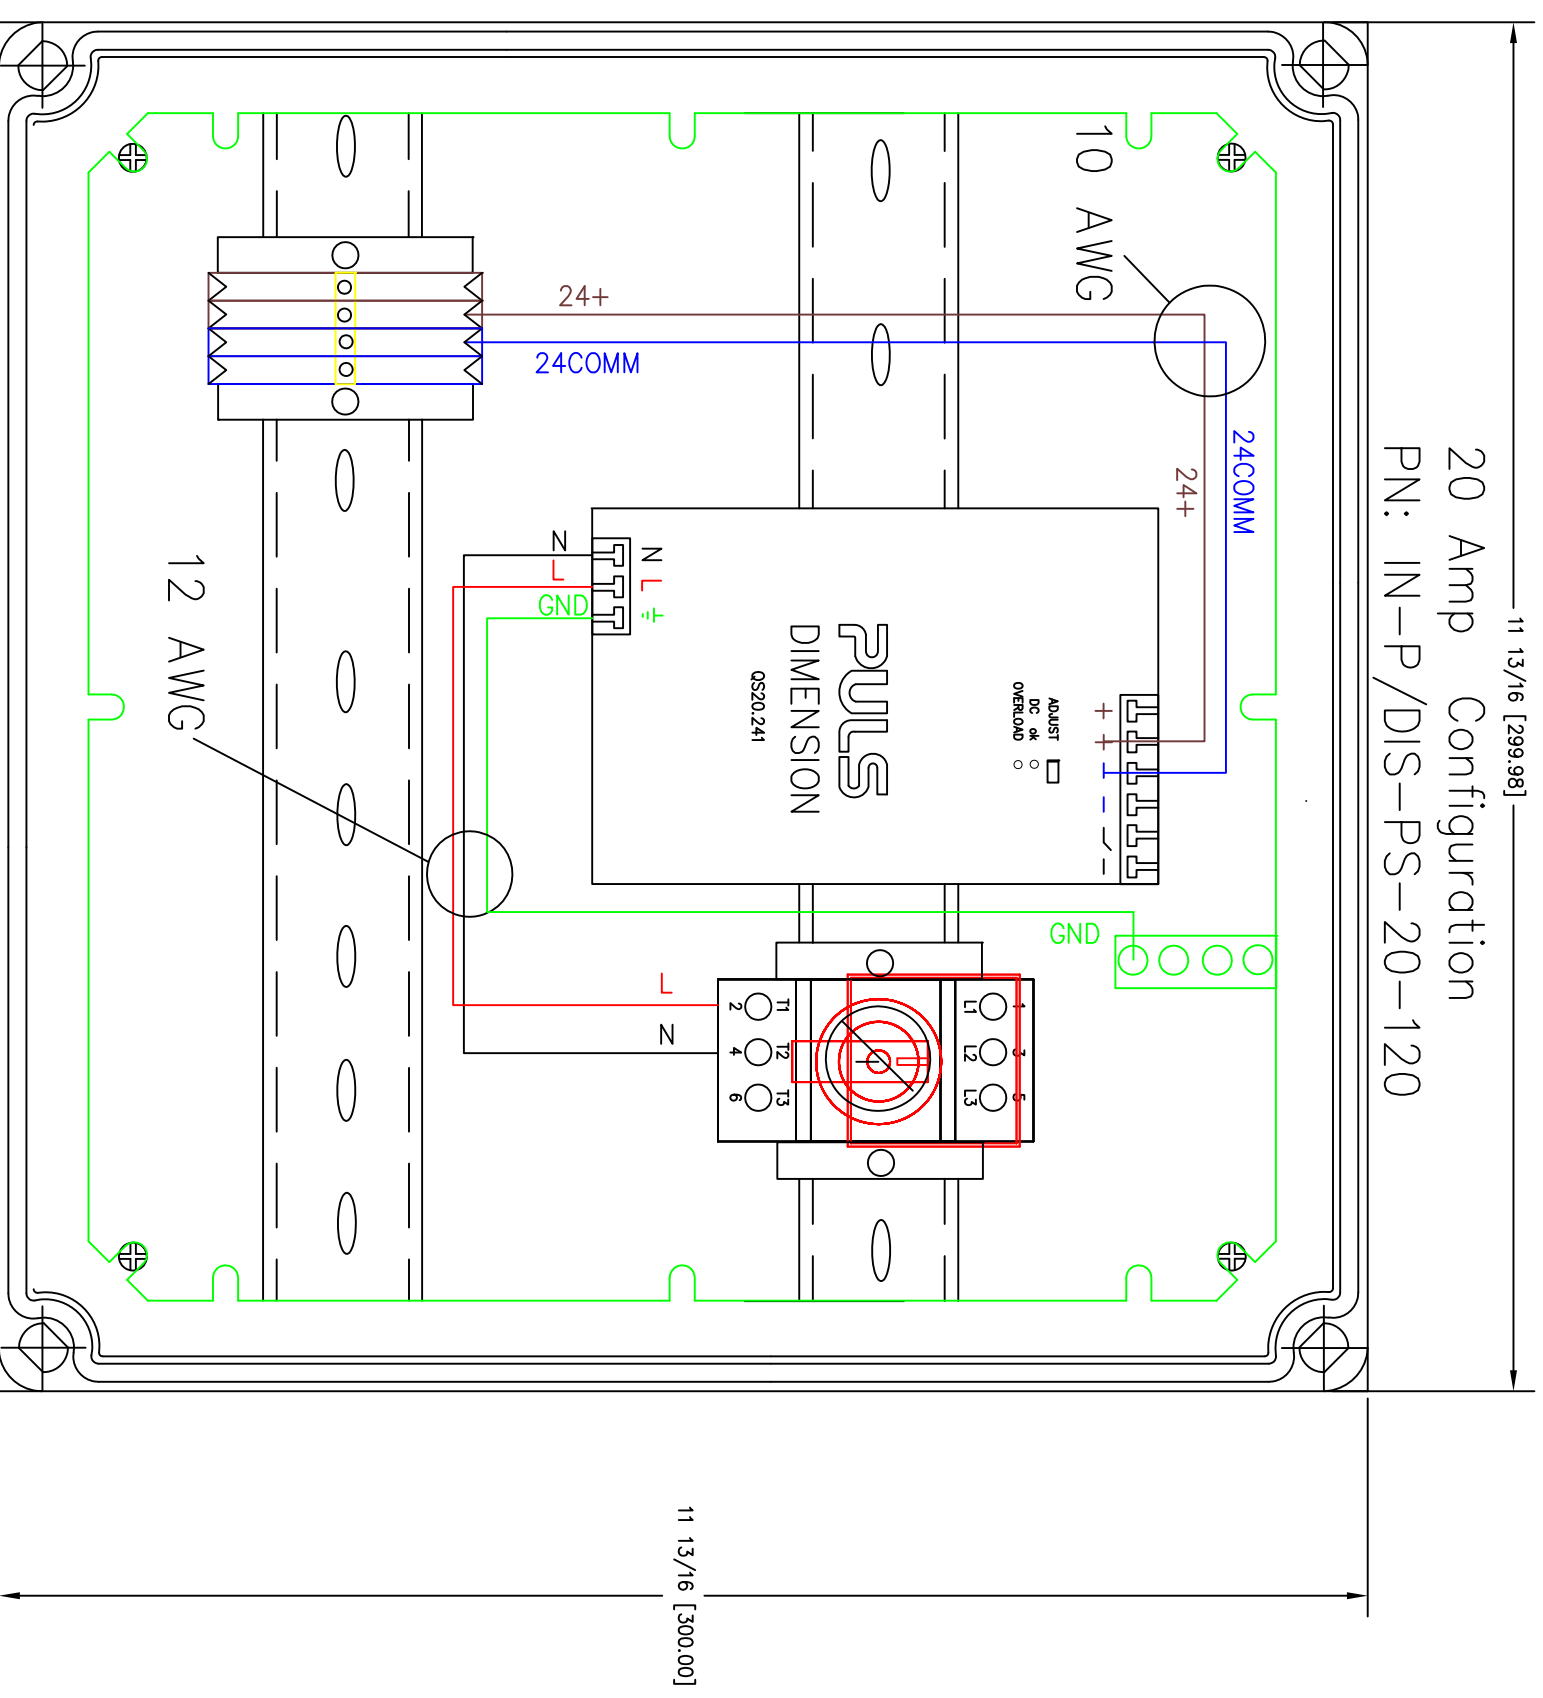

REV.	DATE	DESCRIPTION	ADDED REF. #'s
A	8/4/09		
<p>THE INFORMATION CONTAINED HEREIN IS THE PROPERTY OF INSIGHT AUTOMATION, INC. AND SHALL BE USED ONLY IN CONNECTION WITH THE CONTRACT OF WHICH THIS DRAWING FORMS A PART, AND SHALL NOT, WITHOUT INSIGHT AUTOMATION, INC. PRIOR WRITTEN APPROVAL, BE REPRODUCED OR IN ANY OTHER WAY USED IN WHOLE OR IN PART BY OTHERS.</p>			
DATE:	7/24/09	QUST.NO:	
DESIGNED BY:	T.R.	EST.NO:	
CHECKED BY:		ORD.NO:	
SCALE:	NONE	SHEET:	
TITLE:	MDR POWER 20 Amp 120 VAC		
FOR:	PULS IN-P/DIS-PS-20-120		
DWG. NO:		REV:	

